


Light transmitter LR 110

KEY POINTS

- Range from 0 to 10000 lux
- 0-10 V active output, power supply 24 Vac/Vdc (3-4 wires) or 4-20 mA output, passive loop, power supply from 16 or 30 Vdc (2 wires)
- ABS V0 IP65 housing, with or without display
- "¼ turn" system mounting with wall-mount plate
- Housing with simplified mounting system



FEATURES OF THE HOUSING

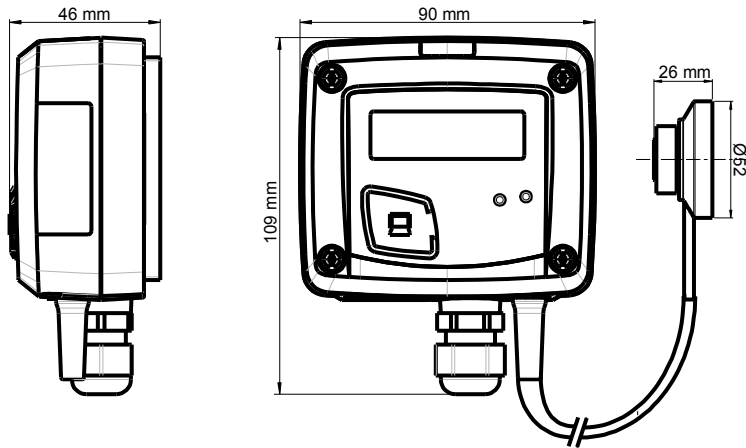

Material : ABS V0 as per UL94

Protection : IP65

Display : LCD 10 digits. Size : 50 x 17 mm

Height of digits : Values : 10 mm ; Units : 5 mm

Cable gland : For cables Ø 8 mm maximum

Weight : 140 g

Remote probe : cable of 2 m length in PVC


TECHNICAL FEATURES

| | |
|------------------------------------|--|
| Units of measurement | lux, fc |
| Measuring ranges | From 0 to 10000 lux From 0 to 929 fc |
| Accuracy* | 3% of reading |
| Resolution | 1 lux 0.1 fc |
| Type of fluid | Air and neutral gases |
| Operating temperature | From 0 to +50 °C |
| Storage temperature | From -10 to +70 °C |
| Spectral response | As per standard photopic curve V (λ) NF C 42-710 class C |
| Error limit V(λ) (f1) | <10 % |
| True cosine evaluation (f2) | <6 % |
| Linearity (f3) | <3 % |

*All the accuracies indicated in this technical datasheet were stated in laboratory conditions, and can be guaranteed for measurements carried out in the same conditions, or carried out with calibration compensation.

PART NUMBER

To order, just add the codes to complete the part number :

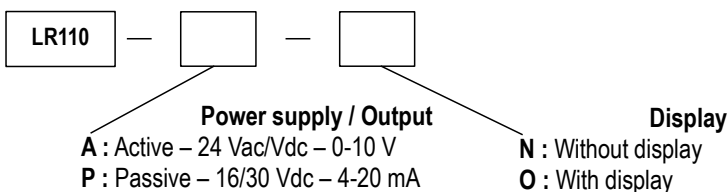


Example : LR110-PO

Light transmitter, 4-20 mA passive transmitter with display

TECHNICAL SPECIFICATIONS

| | |
|--|---|
| Output / Power supply | - active 0-10 V (power supply 24 Vac/Vdc \pm 10%), 3-4 wires - passive loop 4-20 mA (power supply 16/30 Vdc), 2 wires - maximal load : 500 Ohms (4-20 mA) - minimum load : 1 K Ohms (0-10 V) |
| Consumption | 2 VA (0-10 V) or max. 22 mA (4-20 mA) |
| Electromagnetical compatibility | EN61326 |
| Electrical connection | Screw terminal block for cables \varnothing 0.05 to 2.5 mm ² |
| PC communication | Kimo USB-mini Din cable |
| Environment | Air and neutral gases |

CONNECTIONS

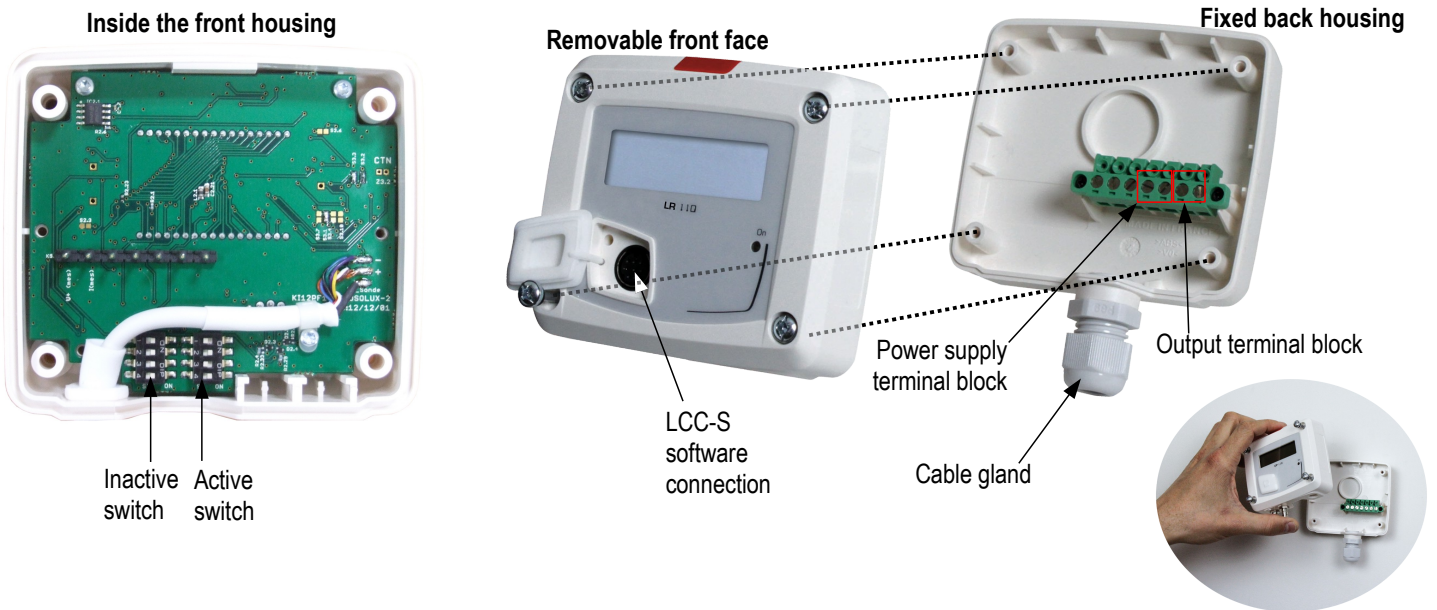


ELECTRICAL CONNECTIONS – as per *NFC15-100 standard*



This connection must be made by a qualified technician. **To make the connection, the transmitter must not be energized.**


For LR110-A models with **0-10 V** output – **active** :

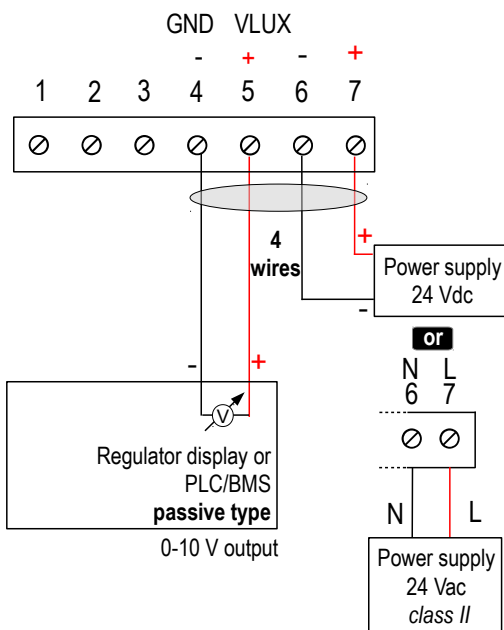

4 wires




To make a 3-wire connection, before powering up the transmitter, please connect the output ground to the input ground. See drawing below.

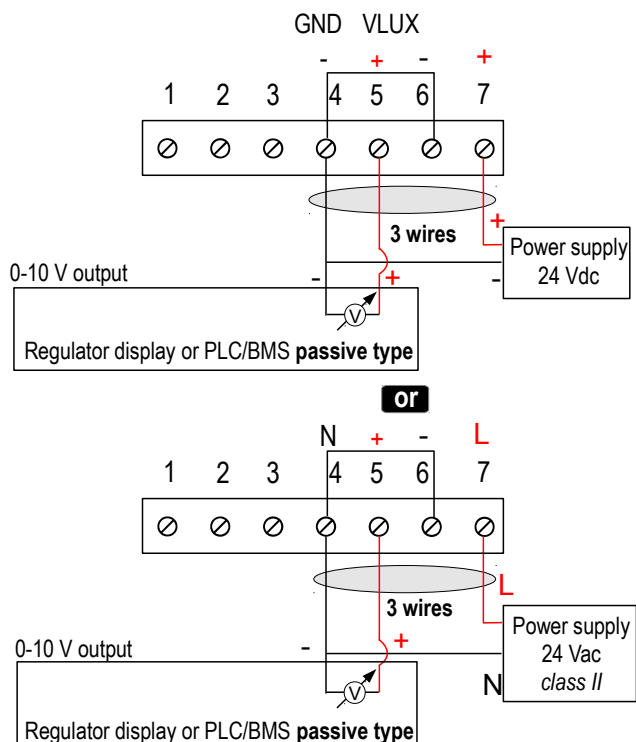

3 wires

For LR110-P models with 4-20 mA output – **passive** :

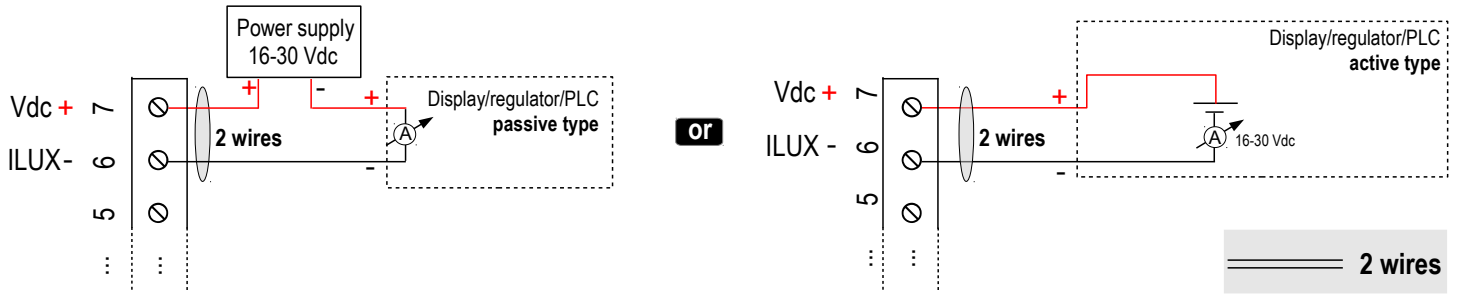


SETTINGS AND USE OF THE TRANSMITTER

> Configuration



To configure the transmitter, it must not be energized. Then you can make the required settings thanks to the DIP switches as shown on the drawing below. When the transmitter is configured, you can power it up.

To configure the transmitter, unscrew the 4 screws of the housing then open it. DIP switches allowing the different settings are accessible.

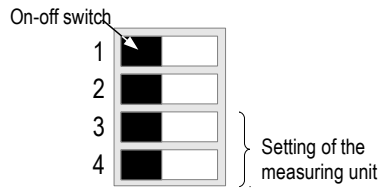

> Measuring unit setting – Active switch


To set the unit of measurement, put the on-off switches 3 and 4 as shown in the table :

| Configurations | lux | fc |
|----------------|-----|----|
| Combinations | 1 | 1 |
| | 2 | 2 |
| | 3 | 3 |
| | 4 | 4 |

CONFIGURATION VIA LCC-S SOFTWARE (optional)

An easy and friendly configuration with the software !


- To access to the configuration via software :
 - Set the switch as shown beside.
 - Connect the cable of the LCC-S to the connection of the transmitter.
- To configure the transmitter, please refer to the LCC-S user manual.



Caution : The configuration of the parameters can be done either by DIP switch, or by software (you cannot combine both solutions).

MOUNTING

To mount the transmitter, mount the ABS plate on the wall (drilling : $\varnothing 6$ mm, screws and pins are supplied). Insert the transmitter on the fixing plate (see A on the drawing beside). Rotate the housing in clockwise direction until you hear a “click” which confirms that the transmitter is correctly installed.

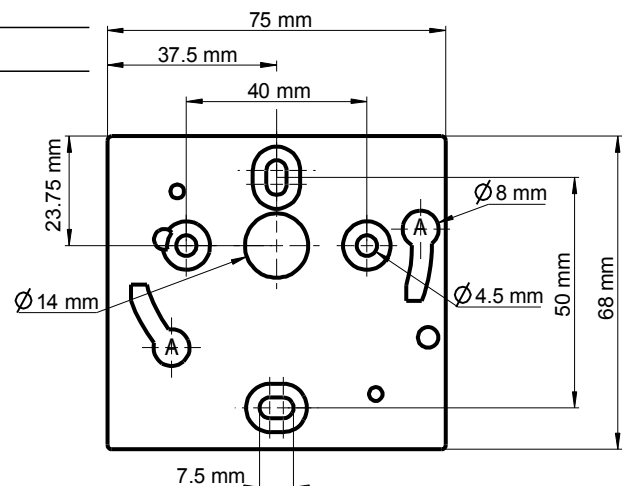

MAINTENANCE

Please avoid any aggressive solvent. Please protect the transmitter and its probes from any cleaning product containing formol, that may be used for cleaning rooms or ducts.

OPTIONS AND ACCESSORIES

- **KIAL-100A** : Power supply class 2 , 230 Vac input, 24 Vac output
- **LCC-S** : configuration software with USB cable

www.kimo.fr



EXPORT DEPARTMENT

Tel : + 33. 1. 60. 06. 69. 25 - Fax : + 33. 1. 60. 06. 69. 29

e-mail : export@kimo.fr

Distributed by : **Instrument Choice**

Call 1300 737 871 for expert advise.

Email: customer-service@instrumentchoice.com.au

www.instrumentchoice.com.au